

iHFG Standard Components

Room Layout Sheet

Room Name

Computer Equipment Room, 8m2

RLS Room Code

coeq-8-i

RDS Room Code

coeq-8-i

- CW

KP

L/LL

LS/R

PO/S-3PH

SK4

V1

WPF
- COLD WATER OUTLET

KICKPLATE

LIGHT - LED LIGHT

LIGHT SWITCH - ROOM

POWER OUTLET - SPECIAL, 3 PHASE

FLOOR VINYL COVERED SKIRTING

VINYL FLOORING, STANDARD SLIP RESISTANT

WALL PAINT FINISH


NOTE: LEAD LINING SHIELDING (AS APPLICABLE)

GENERAL NOTES:

THIS DRAWING TO BE READ IN CONJUNCTION WITH R.D.S. (ROOM DATA SHEETS) WHICH TAKES PRECEDENCE.

ALL SERVICES INDICATED ARE INDICATIVE AND SUBJECTED TO DETAILED PROJECT SPECIFIC ENGINEERING DESIGN.

CEILING LEGEND:




- PBT-PC4
- PLASTERBOARD DROP-IN CEILING TILES WITH POWDERCOAT ALUMINIUM CORNICE, SHADOW ANGLE


TILE CEILING GRID (600 x 600)

GRID LINE

ELECTRICAL LEGEND:



MECHANICAL LEGEND:




RETURN AIR GRILLE


FIRE SERVICES LEGEND:

-
- SMOKE DETECTOR


CLEAN AGENT GAS SUPPRESSION SYSTEM

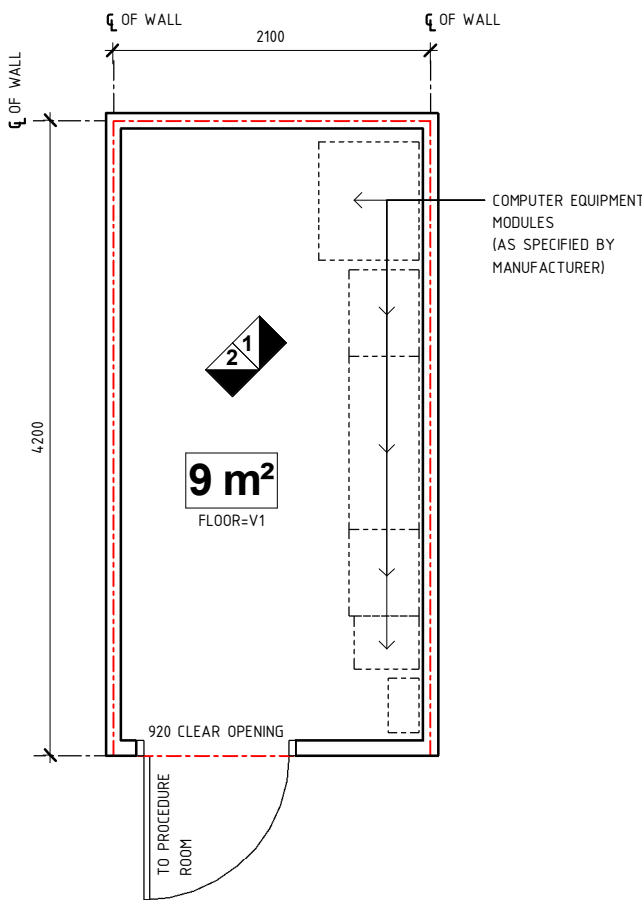

PLAN

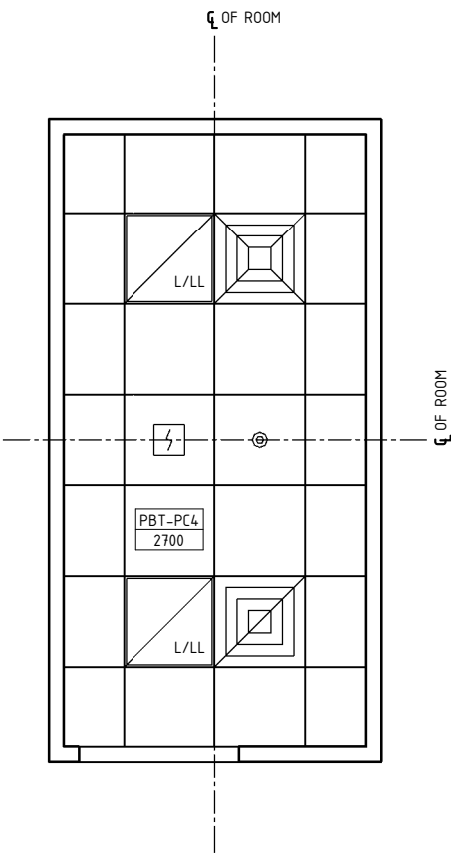


REFLECTED CEILING PLAN

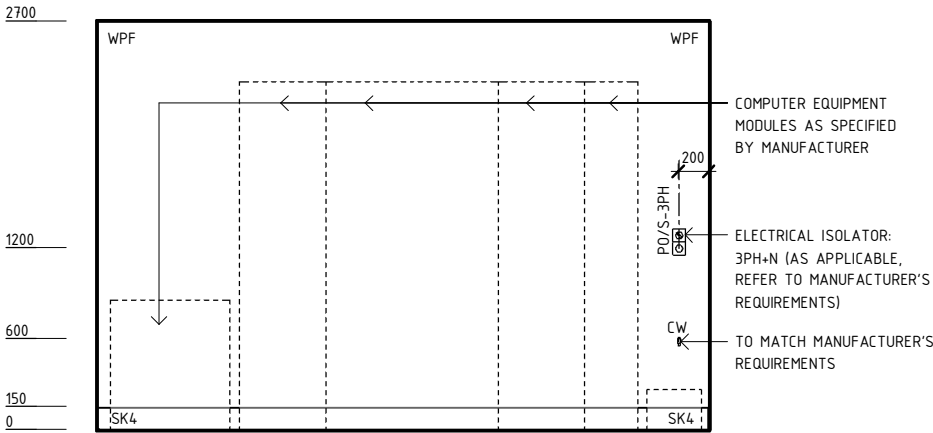


ELEVATION 1

NOTE: PROVIDE CHILLED WATER AND DRAINAGE AS SPECIFIED BY MANUFACTURER.

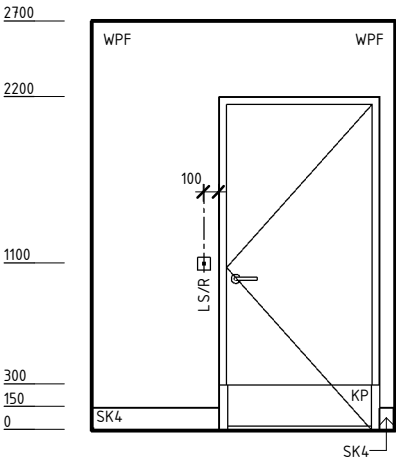

ELEVATION 2

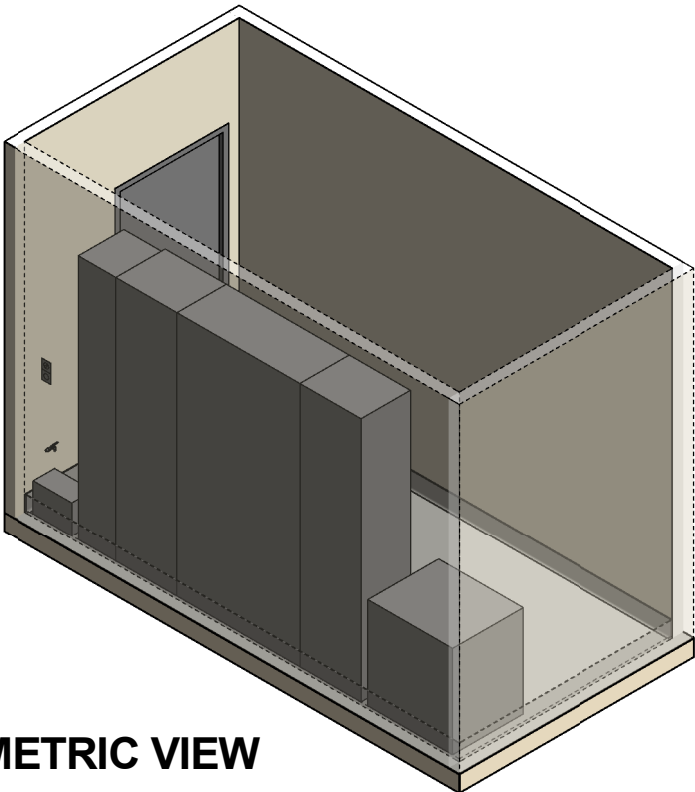

ISOMETRIC VIEW

REV	DESCRIPTION	DATE	BY	REV	DESCRIPTION	DATE	BY	COMPATIBILITY					
1	FIRST ISSUE	24.10.10	CC	4	GENERAL REVISION	31.08.22	RA						
2	GENERAL REVISION	30.08.11	MT										
3	GENERAL REVISION	31.10.12	KC										
International Health Facility Guidelines International Health Facility Guidelines at: www.healthdesign.com.au/iHFG Editable version of Standard Components on Health Facility Briefing System (HFBS) at: www.healthdesign.com.au ©TAHPI 									DESIGNED	APPROVED	DATE	SCALE(S)	SHEET
RA		RH		31.08.22		1 : 50		1 OF 1					
REVIT FILE NAME				PAPER DRAWING ID				ISSUE					
coeq-8-i				coeq-8-i-1				4					

This document is for advisory purpose only